

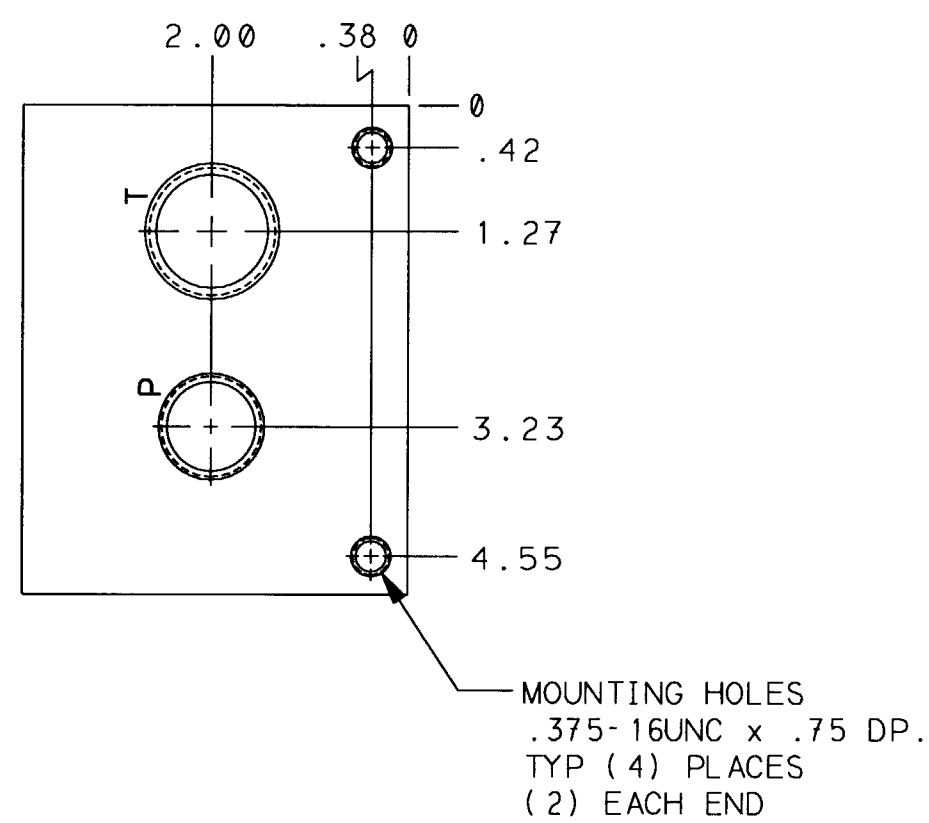


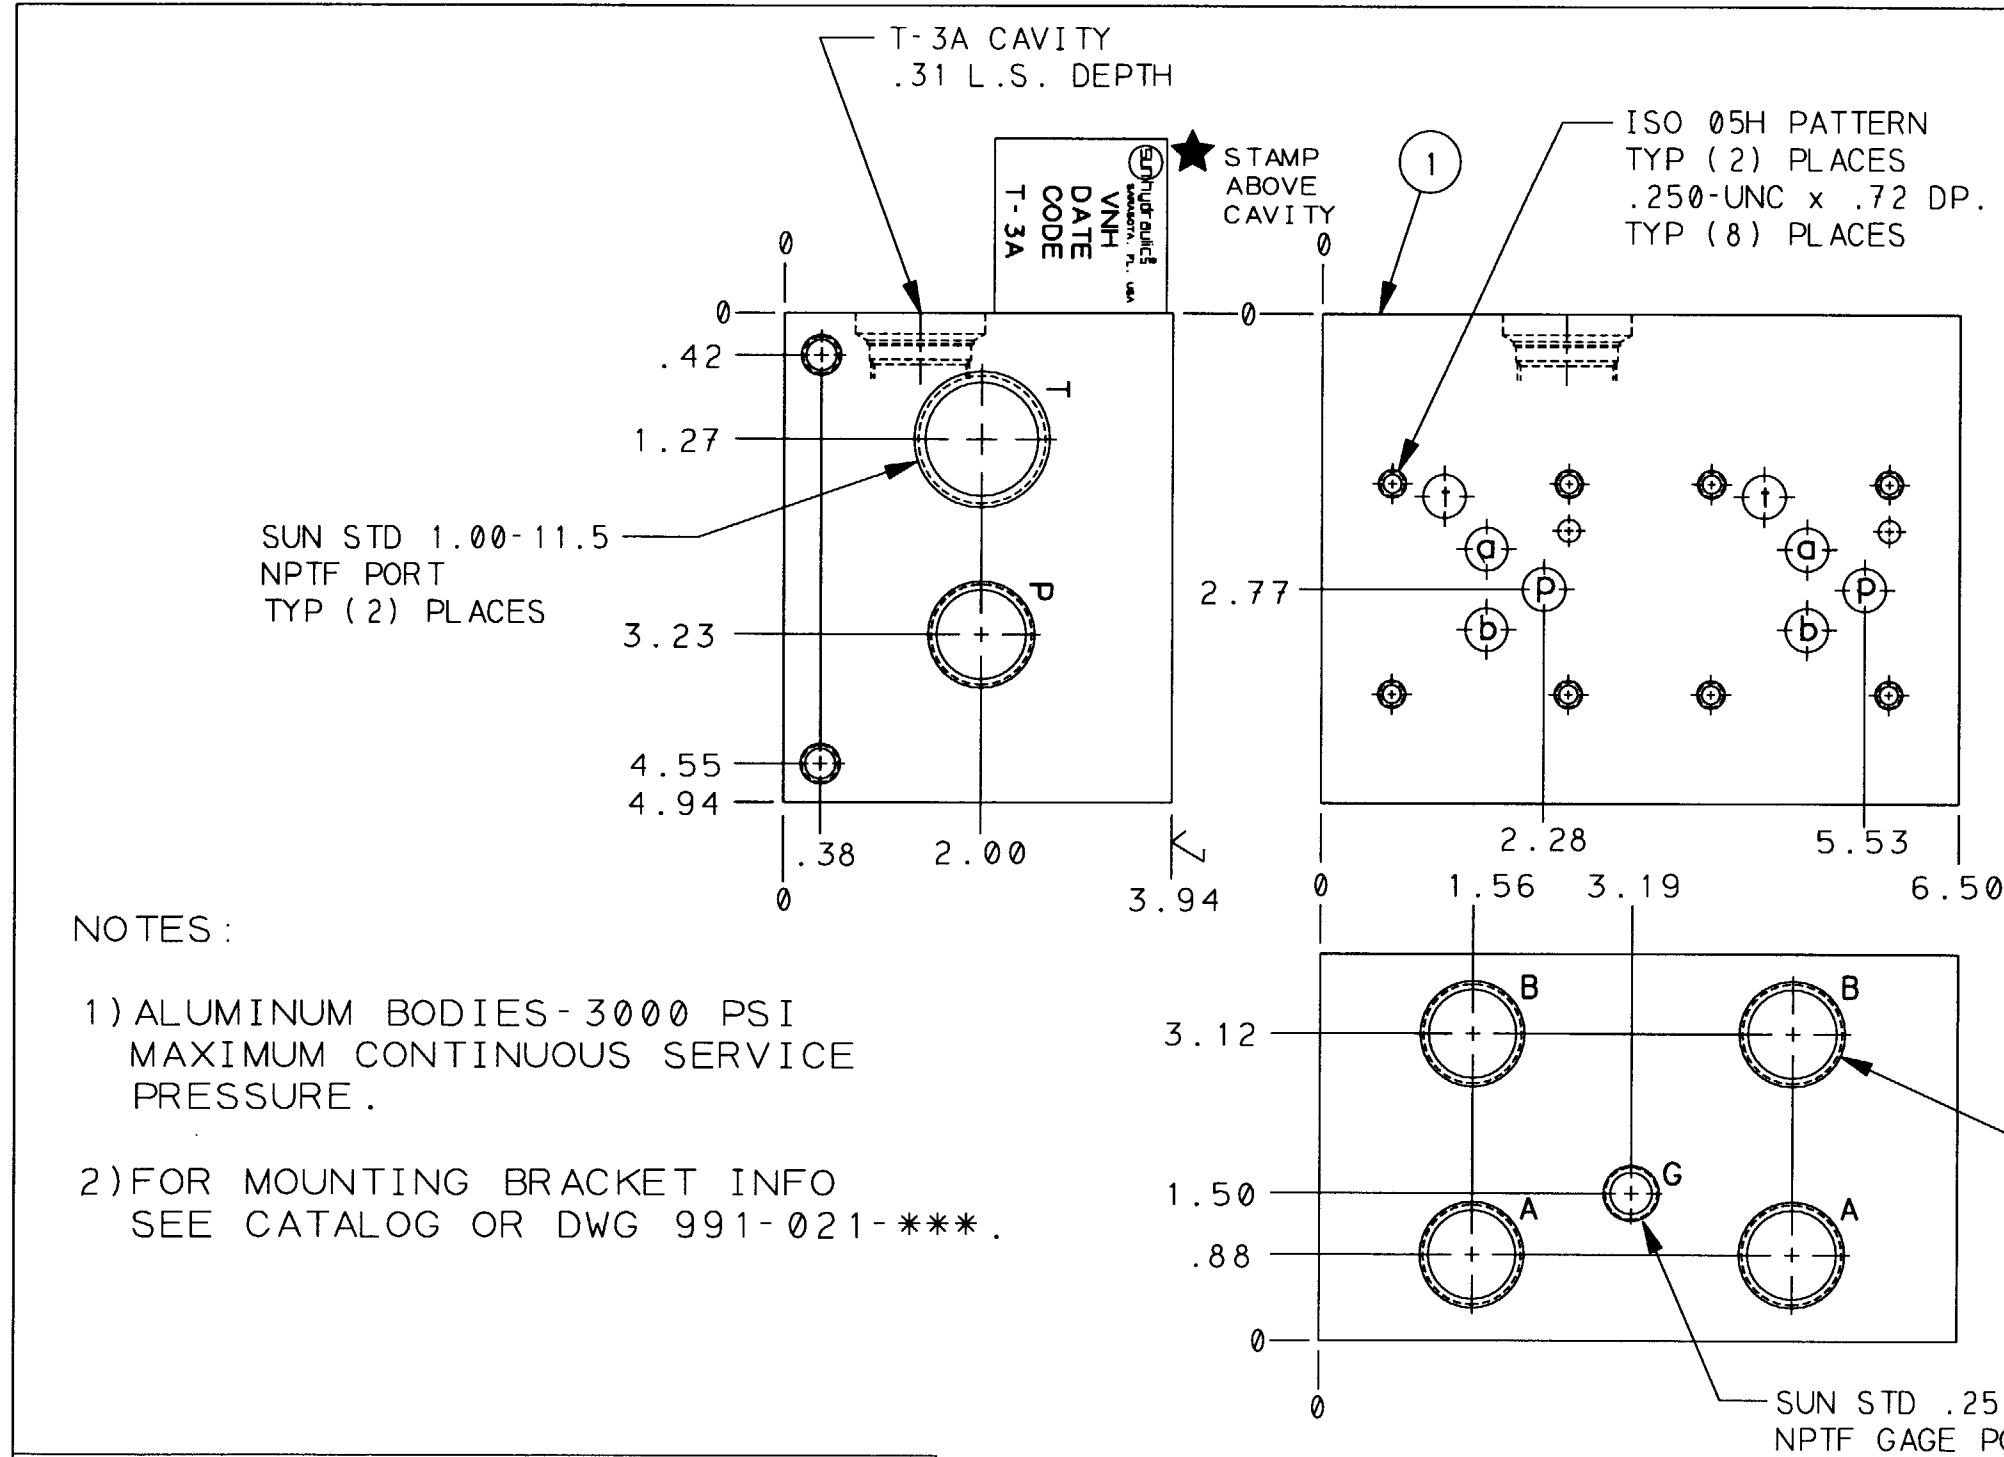

- NOTES :
- 1) ALUMINUM BODIES-3000 PSI  
MAXIMUM CONTINUOUS SERVICE  
PRESSURE .
  - 2) FOR MOUNTING BRACKET INFO  
SEE CATALOG OR DWG 991-021-\*\*\*.

SUN STD .750-14 NPTF PORT  
TYP (6) PLACES  
PORTS "A", "B" & "P"

SUN STD .250-18  
NPTF GAGE PORT

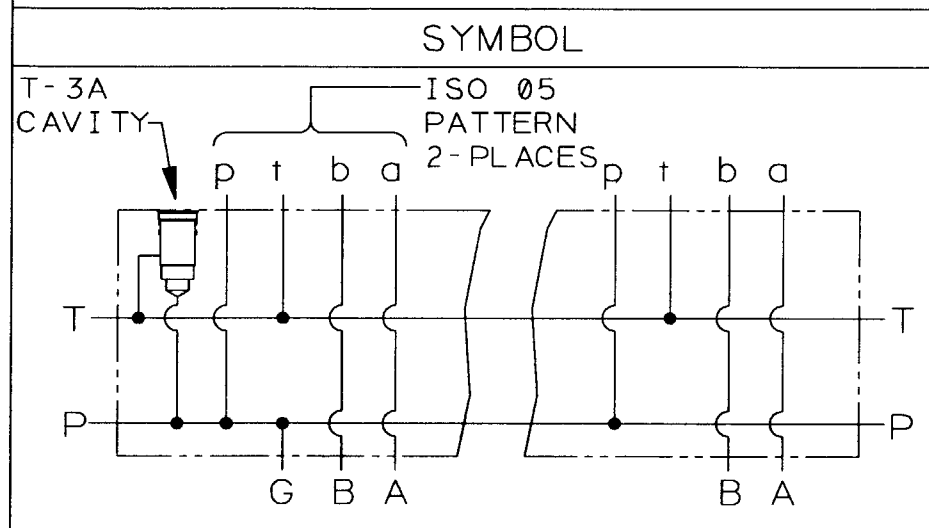

| LET | REVISION | DATE | DRN | CHK | REL |
|-----|----------|------|-----|-----|-----|
|     |          |      |     |     |     |
|     |          |      |     |     |     |
|     |          |      |     |     |     |
|     |          |      |     |     |     |
|     |          |      |     |     |     |
|     |          |      |     |     |     |
|     |          |      |     |     |     |
|     |          |      |     |     |     |
|     |          |      |     |     |     |
|     |          |      |     |     |     |

| UNLESS OTHERWISE SPECIFIED |  |  |  | TITLE                             |  | REVISION |  | PART NO. |  | VNH                 |  |
|----------------------------|--|--|--|-----------------------------------|--|----------|--|----------|--|---------------------|--|
| DIMENSION TOL              |  |  |  | TWO STATION ISO 05H BAR MANIFOLD  |  | SCALE    |  | REF.     |  | MATERIAL            |  |
| .x = ±.030                 |  |  |  | PARALLEL CIRCUIT, W/RELIEF CAVITY |  | 1/2      |  |          |  |                     |  |
| .xx = ±.015                |  |  |  | DRAWN                             |  | CHECK    |  | RELEASE  |  | HEAT TREAT & FINISH |  |
| .xxx = ±.005               |  |  |  | BR5                               |  |          |  | 5329     |  |                     |  |
| ANGLE TOL ± 1/2            |  |  |  | DATE                              |  | DATE     |  | DATE     |  |                     |  |
| FINISH 80✓                 |  |  |  | 05 JAN94                          |  |          |  |          |  |                     |  |
| REMOVE ALL BURRS           |  |  |  |                                   |  |          |  |          |  |                     |  |

